
GDI ALLGAS ENERGY PTY LTD NETWORKS

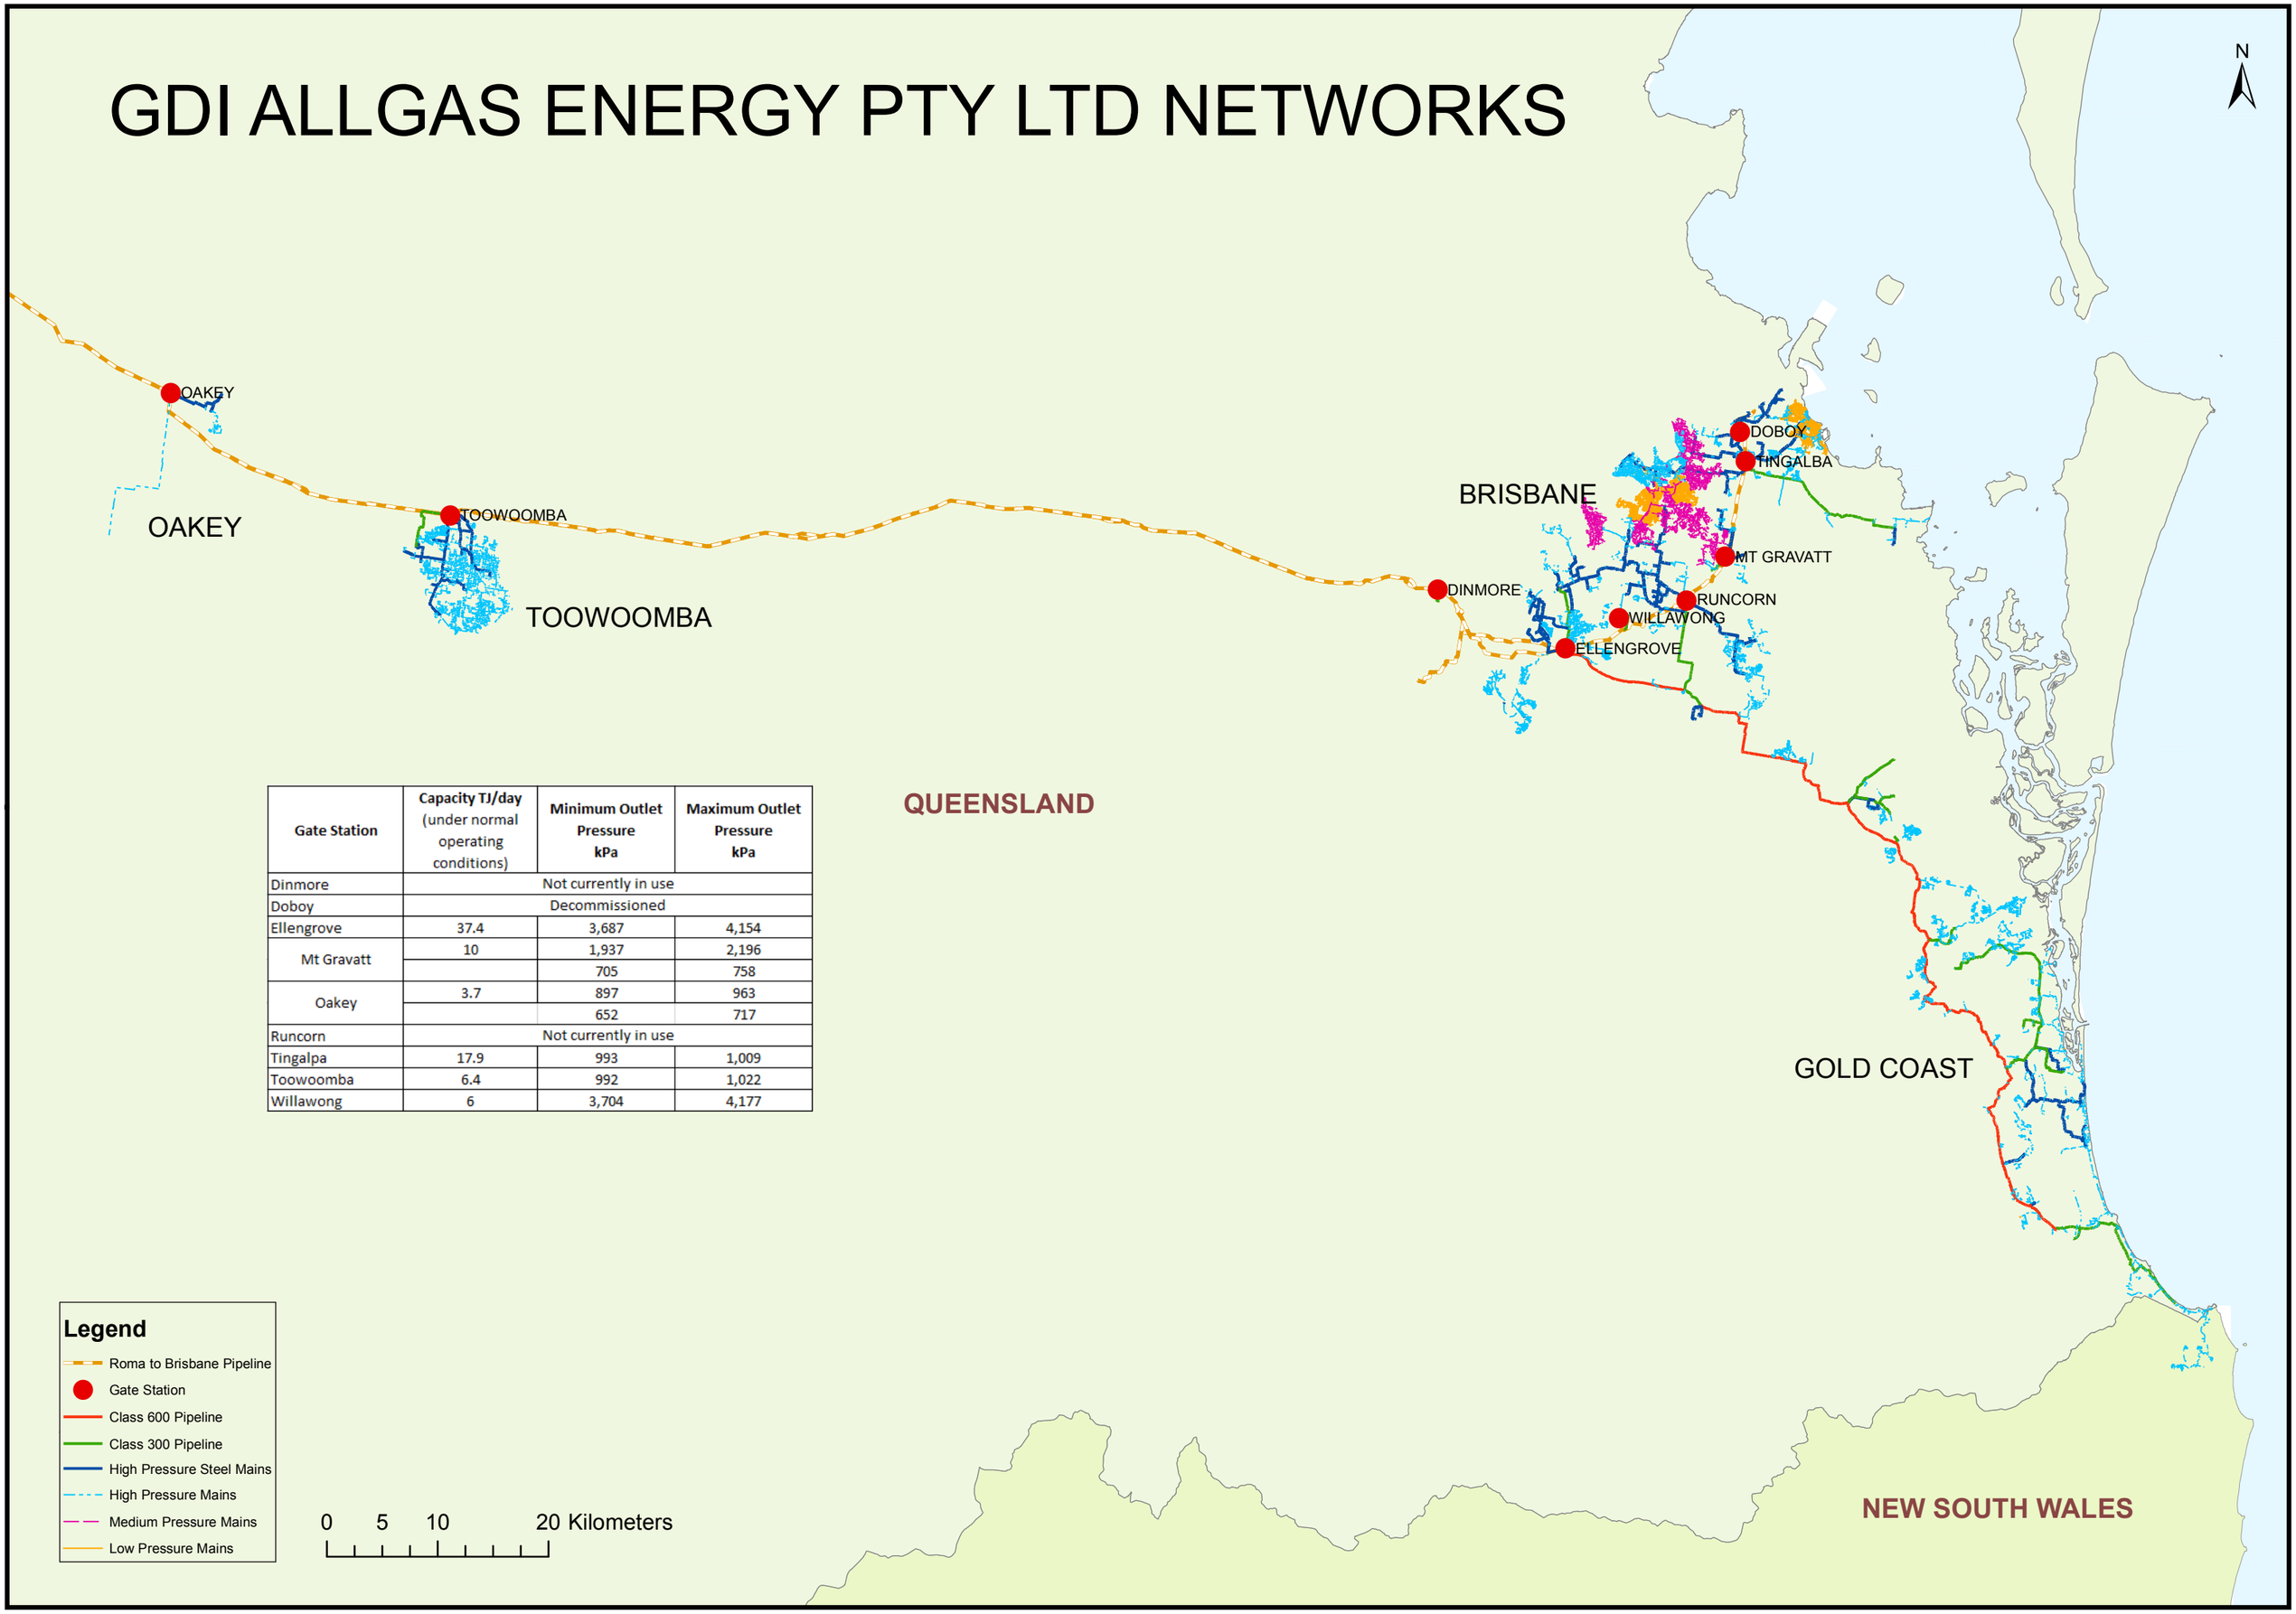

Gate Station	Capacity TJ/day (under normal operating conditions)	Minimum Outlet Pressure kPa	Maximum Outlet Pressure kPa
Dinmore	Not currently in use		
Doboy	Decommissioned		
Ellengrove	37.4	3,687	4,154
Mt Gravatt	10	1,937	2,196
		705	758
Oakey	3.7	897	963
		652	717
Runcorn	Not currently in use		
Tingalpa	17.9	993	1,009
Toowoomba	6.4	992	1,022
Willawong	6	3,704	4,177